

NOTICE OF SERVICE INTERRUPTION/WORK FORM


Date of Request (yyyy/mm/dd): _____		Requester: _____	
Start Date – End			
Start Date (yyyy/mm/dd) _____	Time (s) _____	Notes _____	
End Date (yyyy/mm/dd) _____	Time (s) _____	_____	
Building(s) Affected:		1: _____	2: _____
		3: _____	4: _____
Areas/Rooms Affected: _____			
Service to be interrupted:		1: _____	2: _____
		3: _____	4: _____
Description/Reason for Project:			
Contractor: _____		Phone #: _____	
Contractor/Project Managers: _____		Phone #: _____	
Should you have any questions or concerns, please contact			
Notes:			

- Day 1 Oct 2
- Day 2 Oct 3
- Day 3 Oct 4
- Day 4 Oct 5
- Day 5 Oct 6

NOTES:

1. NEW FIXTURE WITH NEW 16FT ROUND POLE. MODIFY BASE TO SUIT EXIST CONCRETE BASE.
2. NEW FIXTURE WITH NEW 20FT ROUND POLE. MODIFY BASE TO SUIT EXIST CONCRETE BASE.

Sea Can Drop off.

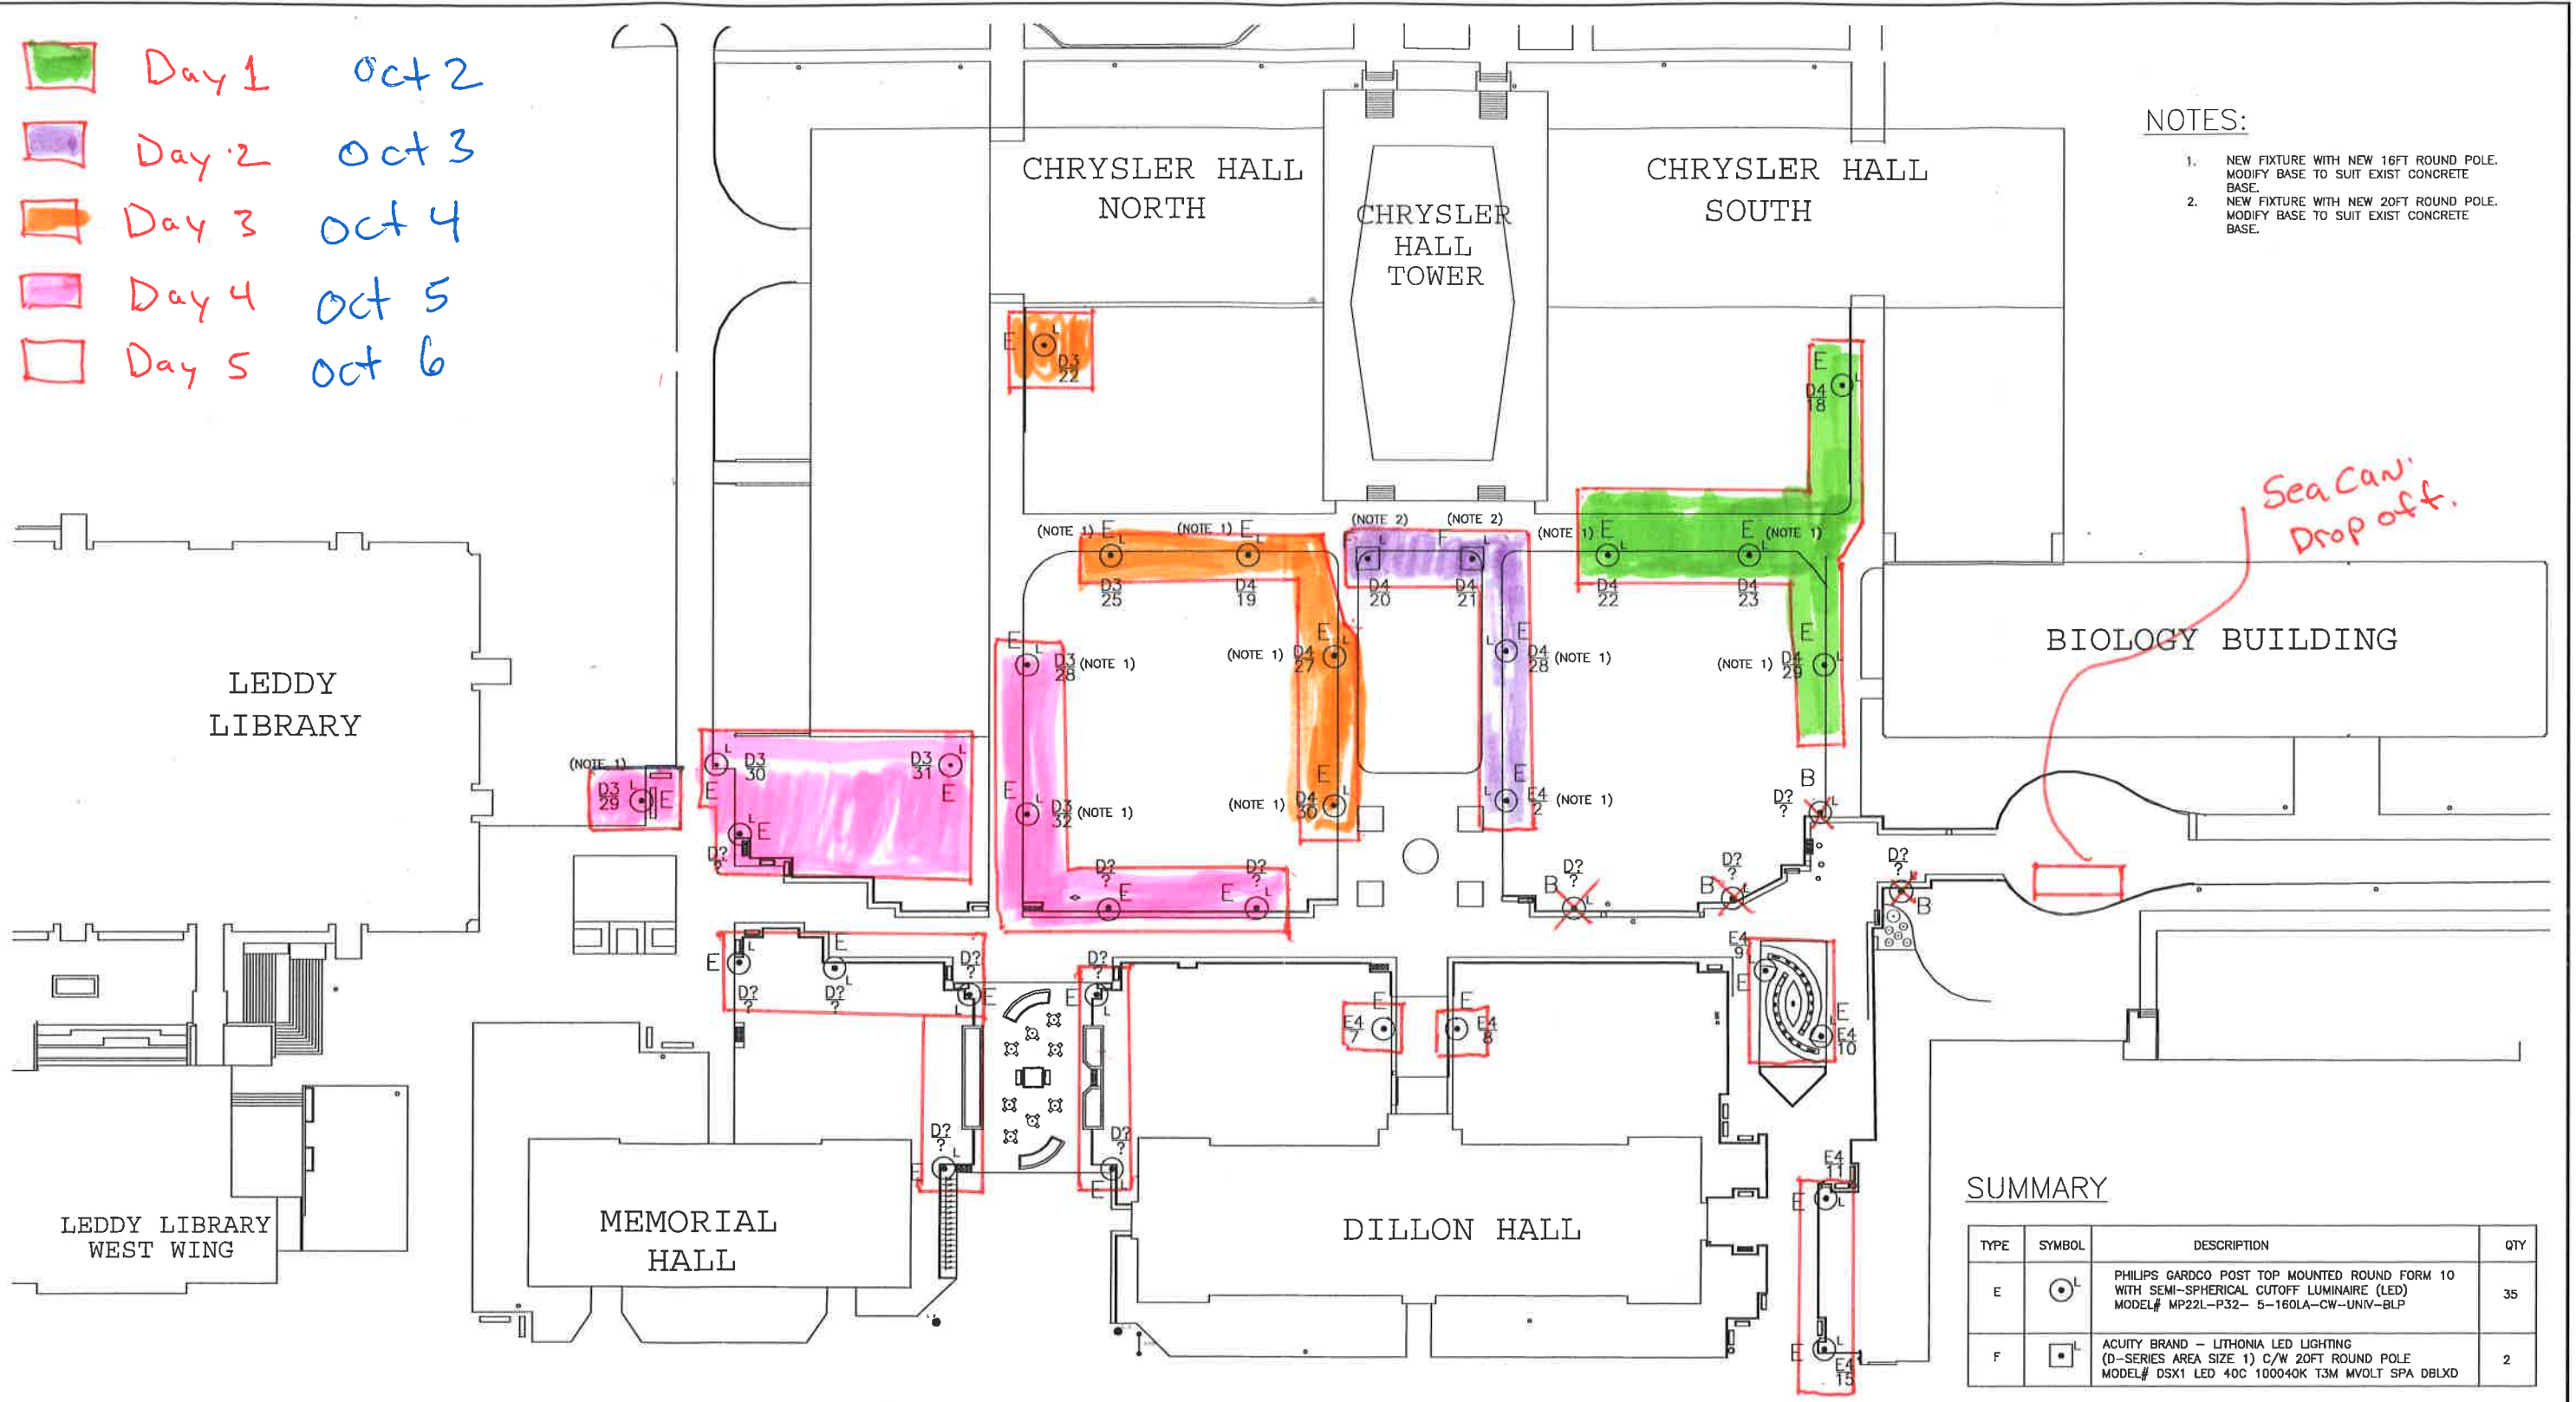

SUMMARY

TYPE	SYMBOL	DESCRIPTION	QTY
E	⊙	PHILIPS GARDCO POST TOP MOUNTED ROUND FORM 10 WITH SEMI-SPHERICAL CUTOFF LUMINAIRE (LED) MODEL# MP22L-P32- 5-160LA-CW-UNV-BLP	35
F	⊠	ACUITY BRAND - LITHONIA LED LIGHTING (D-SERIES AREA SIZE 1) C/W 20FT ROUND POLE MODEL# DSX1 LED 40C 100040K T3M MVOLT SPA DBLXD	2

Conditions of Use
 Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.
 Do not scale dimensions from drawing.
 Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.



NO.	ISSUED FOR	DATE	BY
2	CONSTRUCTION	05/05/2017	BLD
1	ADDENDUM No 1	01/05/2017	BLD
0	CLIENT REVIEW	DEC 2016	BLD

DESIGN	BLD	REVIEWED BY	BLD
DRAWN	PRP	CHECKED BY	BLD
DATE	DEC 2016		
SCALE	1/32"=1'-0"		
UNIVERSITY OF WINDSOR CAMPUS WALKWAY LIGHTING			
ELECTRICAL			
INSTALLTION			
PROJECT NO.	16-4560		
SHEET NO.	E-200		